


KEY

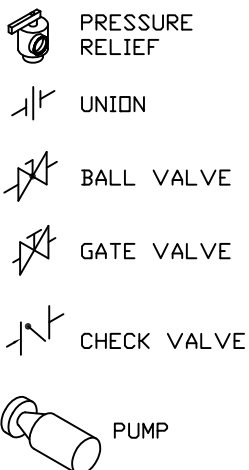

NOTES:

1. SIZING BASED ON BOILER AND TANK BEING PLACED 5 FEET APART. IF BOILER IS PLACED FURTHER THAN 5 FEET FROM TANK(S), PUMP(S) MUST ACCOMMODATE ADDITIONAL PIPING.
2. COLD WATER MUST BE INSTALLED BETWEEN BOILER OUTLET AND TANK(S).
3. A MINIMUM OF 105 DEG. F REQUIRED AT BOILER INLET.
4. PLUMB SWING CHECK VALVE IN GRAVITY CLOSED POSITION.

GUARANTEED 80% DRAW WITHOUT TEMPERATURE DROP, USING RAYPAK BOILERS, TANKS, SIZING TABLES AND HOOK UP DATA

DIAGRAM - PIPING, TWO BOILERS ONE TANK - FREEZE PAK PROTECTION

BOILER SHOWN REPRESENTS VARIOUS MODELS. SEE SPECIFIC BOILER INFORMATION FOR DETAILS BECAUSE MODELS WILL VARY IN DRAFT HOOD DESIGN AND SIZE

PERFORMANCE ENGINEERING GROUP

32995 INDUSTRIAL ROAD
LIVONIA, MI 48150
734-266-5300

3/07/13

PEG-SPEC