


ΔT (F°)	TARGET GPM PER BOILER	BOILER SIZE	PIPE SIZE	
			A	B
40	75	XTHERM H-2005	4"	2-1/2"

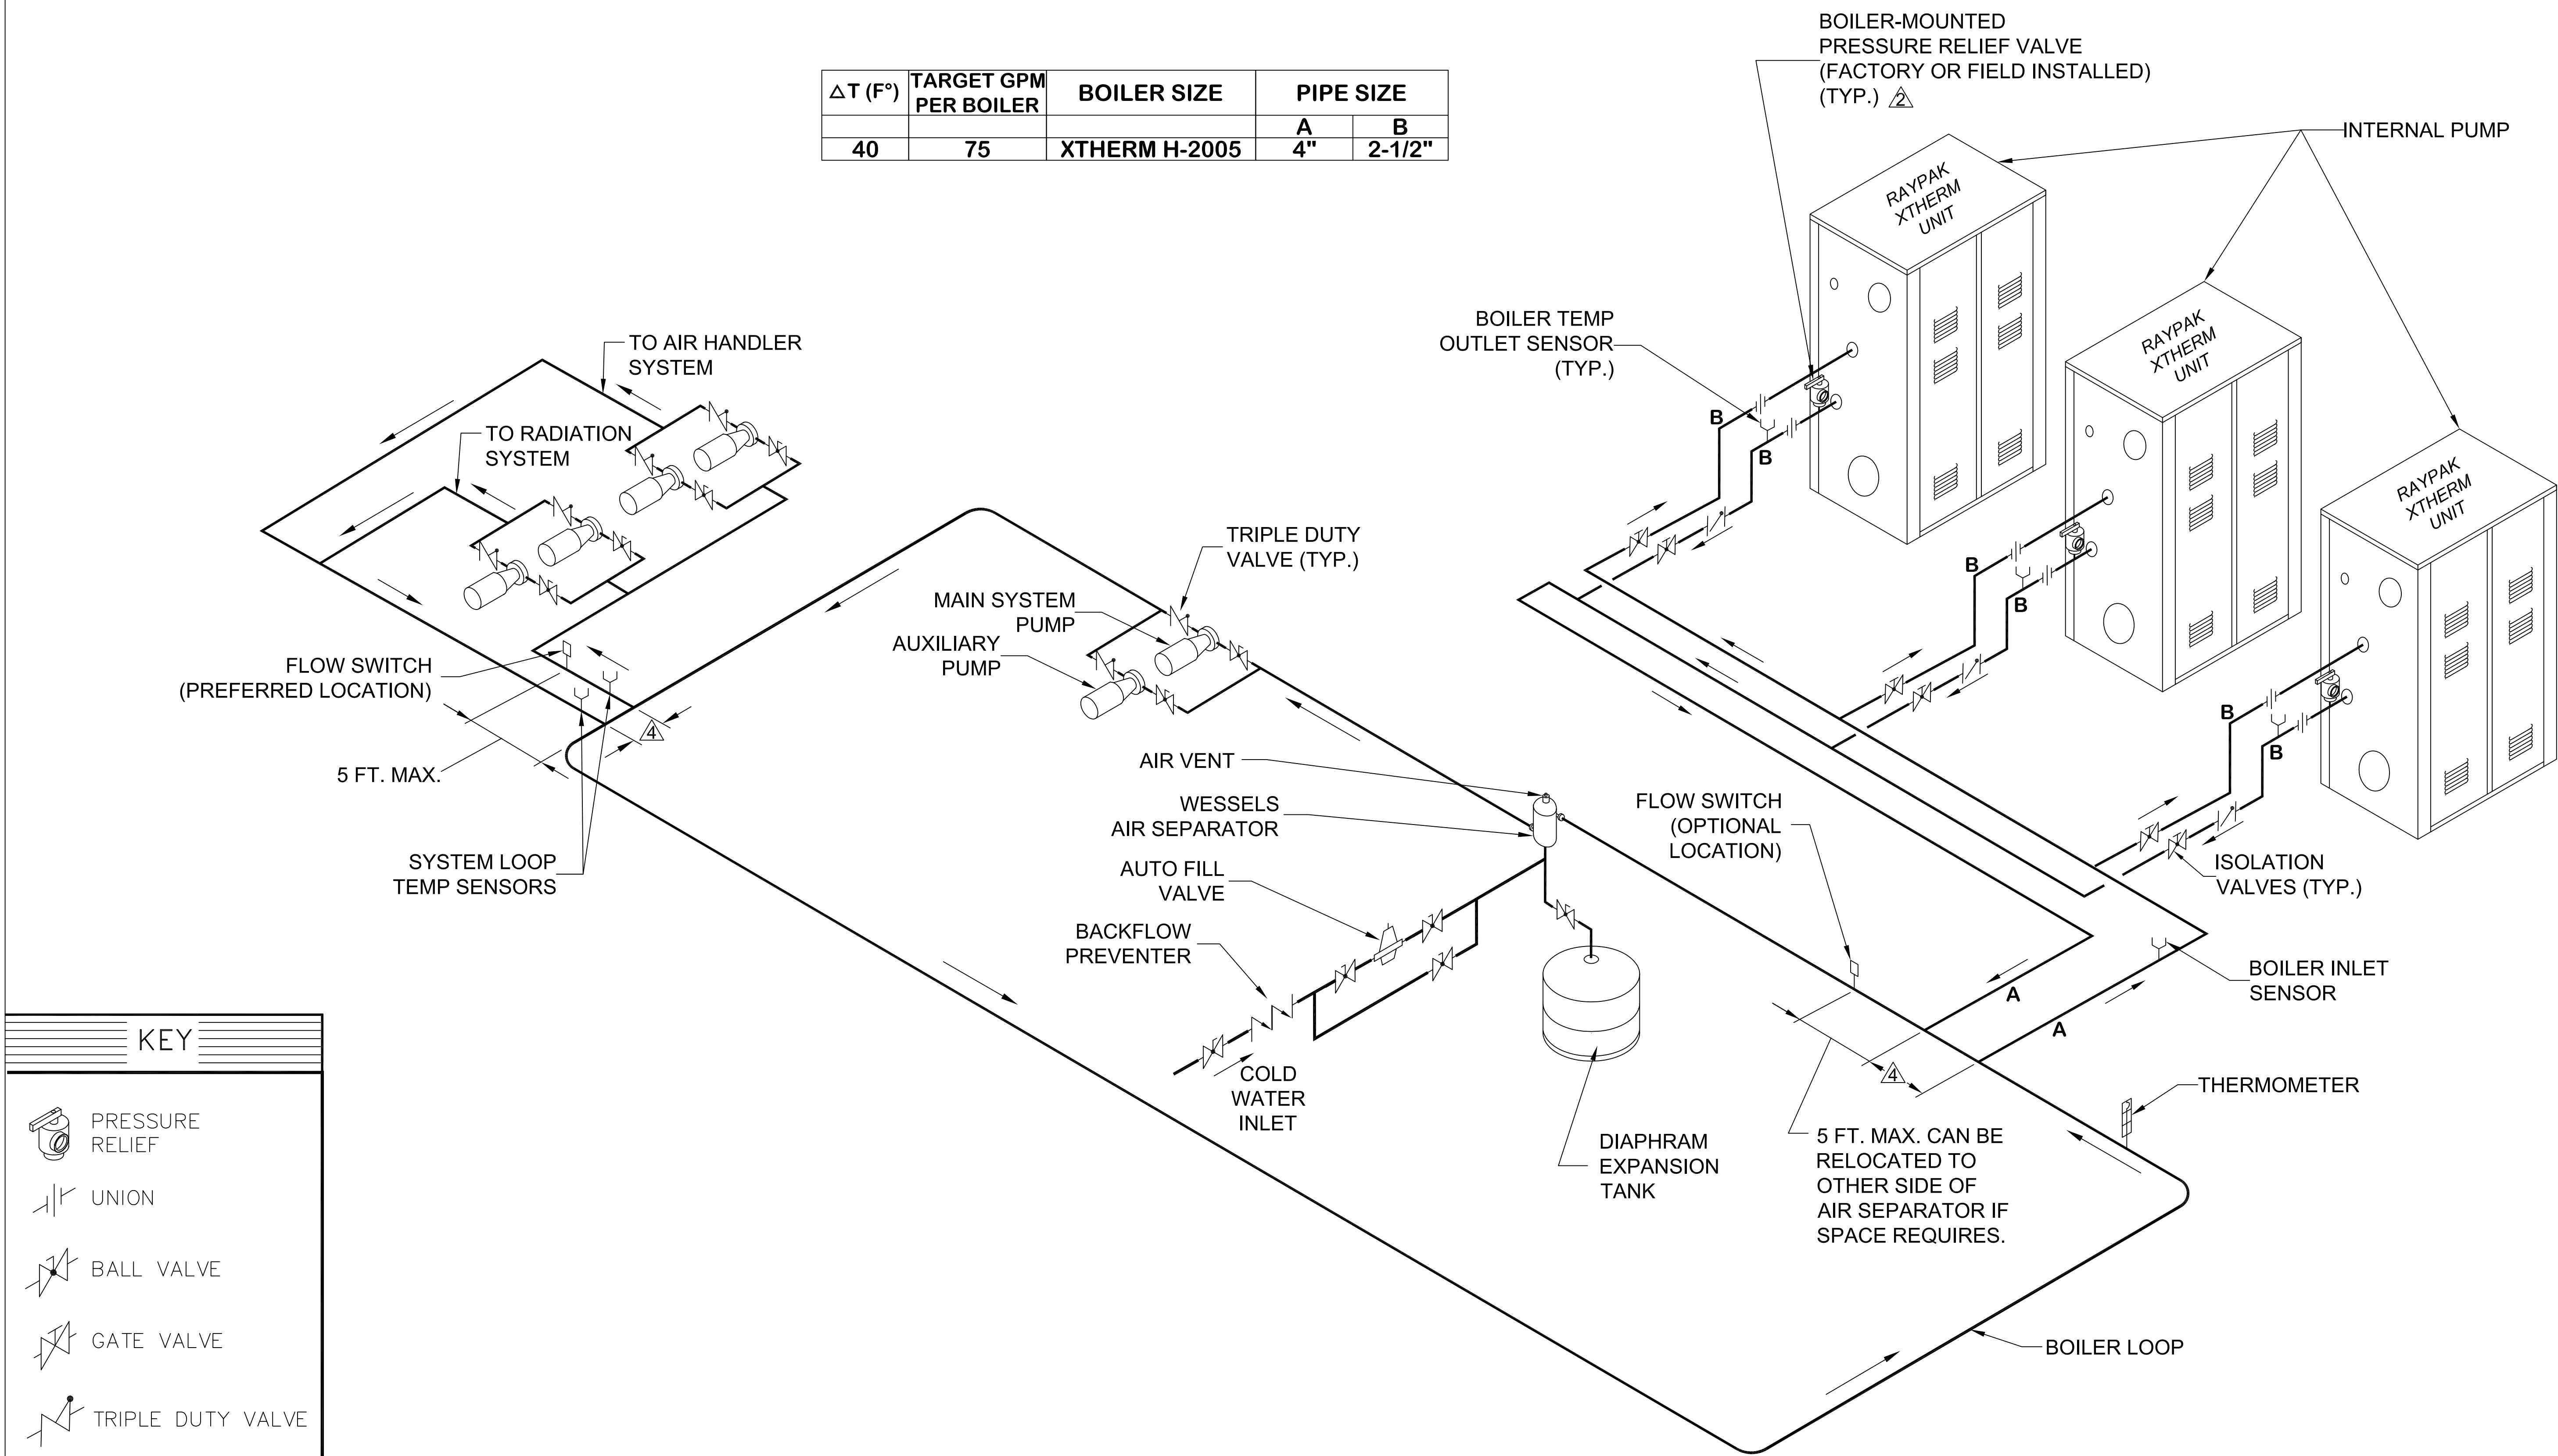

KEY

PRESSURE RELIEF

UNION

BALL VALVE

GATE VALVE

TRIPLE DUTY VALVE

CHECK VALVE

THERMOMETER

PUMP

- NOTES:
1. PLUMB SWING CHECK VALVE IN GRAVITY-CLOSED POSITION.
 2. PIPE ALL RELIEF VALVES TO DRAIN, OR AS LOCAL CODES REQUIRE.
NOTE: RELIEF VALVE MAY HAVE TO BE INSTALLED IN PIPING BY CONTRACTOR.
 3. LOCATE UNIONS TO FACILITATE SERVICING OF PLUMBING SIDE.
 4. MAXIMUM 4 TIMES THE PIPE DIAMETER OR 12" WHICHEVER IS LESS.

LIABILITY

This drawing and our recommendations and suggestions, are intended to assist our customers. Our design represents our best judgment based on our experience and the best facts provided to us, any use thereof is at the sole risk of the customer.

It is assumed that the customer will install the THAW-PAK system in compliance with all local, state and national codes.

CONSULTANTS:

EXPERT MECH. SERVICES

WYANDOTTE MICHIGAN

THAW-PAK

THAW-PAK Radiant Heating Systems

PROJECT NAME:

BOULEVARD TEMPLE NURSING CARE

MICHIGAN DETROIT

THAW-PAK DISTRIBUTOR:

PERFORMANCE engineering group

DRAWN BY:

Gordon Faustich

REVIEWED BY:

APPROVED BY:

ISSUED FOR

02/10/11 SUBMITTAL

PROPERTY OF THAW-PAK

This drawing is the property of THAW-PAK. It has been prepared to assist in the installation of our system. Customer agrees to keep this drawing or copies thereof without our written consent.

DRAWING NO.


PEG11-005P

SHEET NO.

P1

VENTING PLAN

SCALE: 1" = 1'-0"

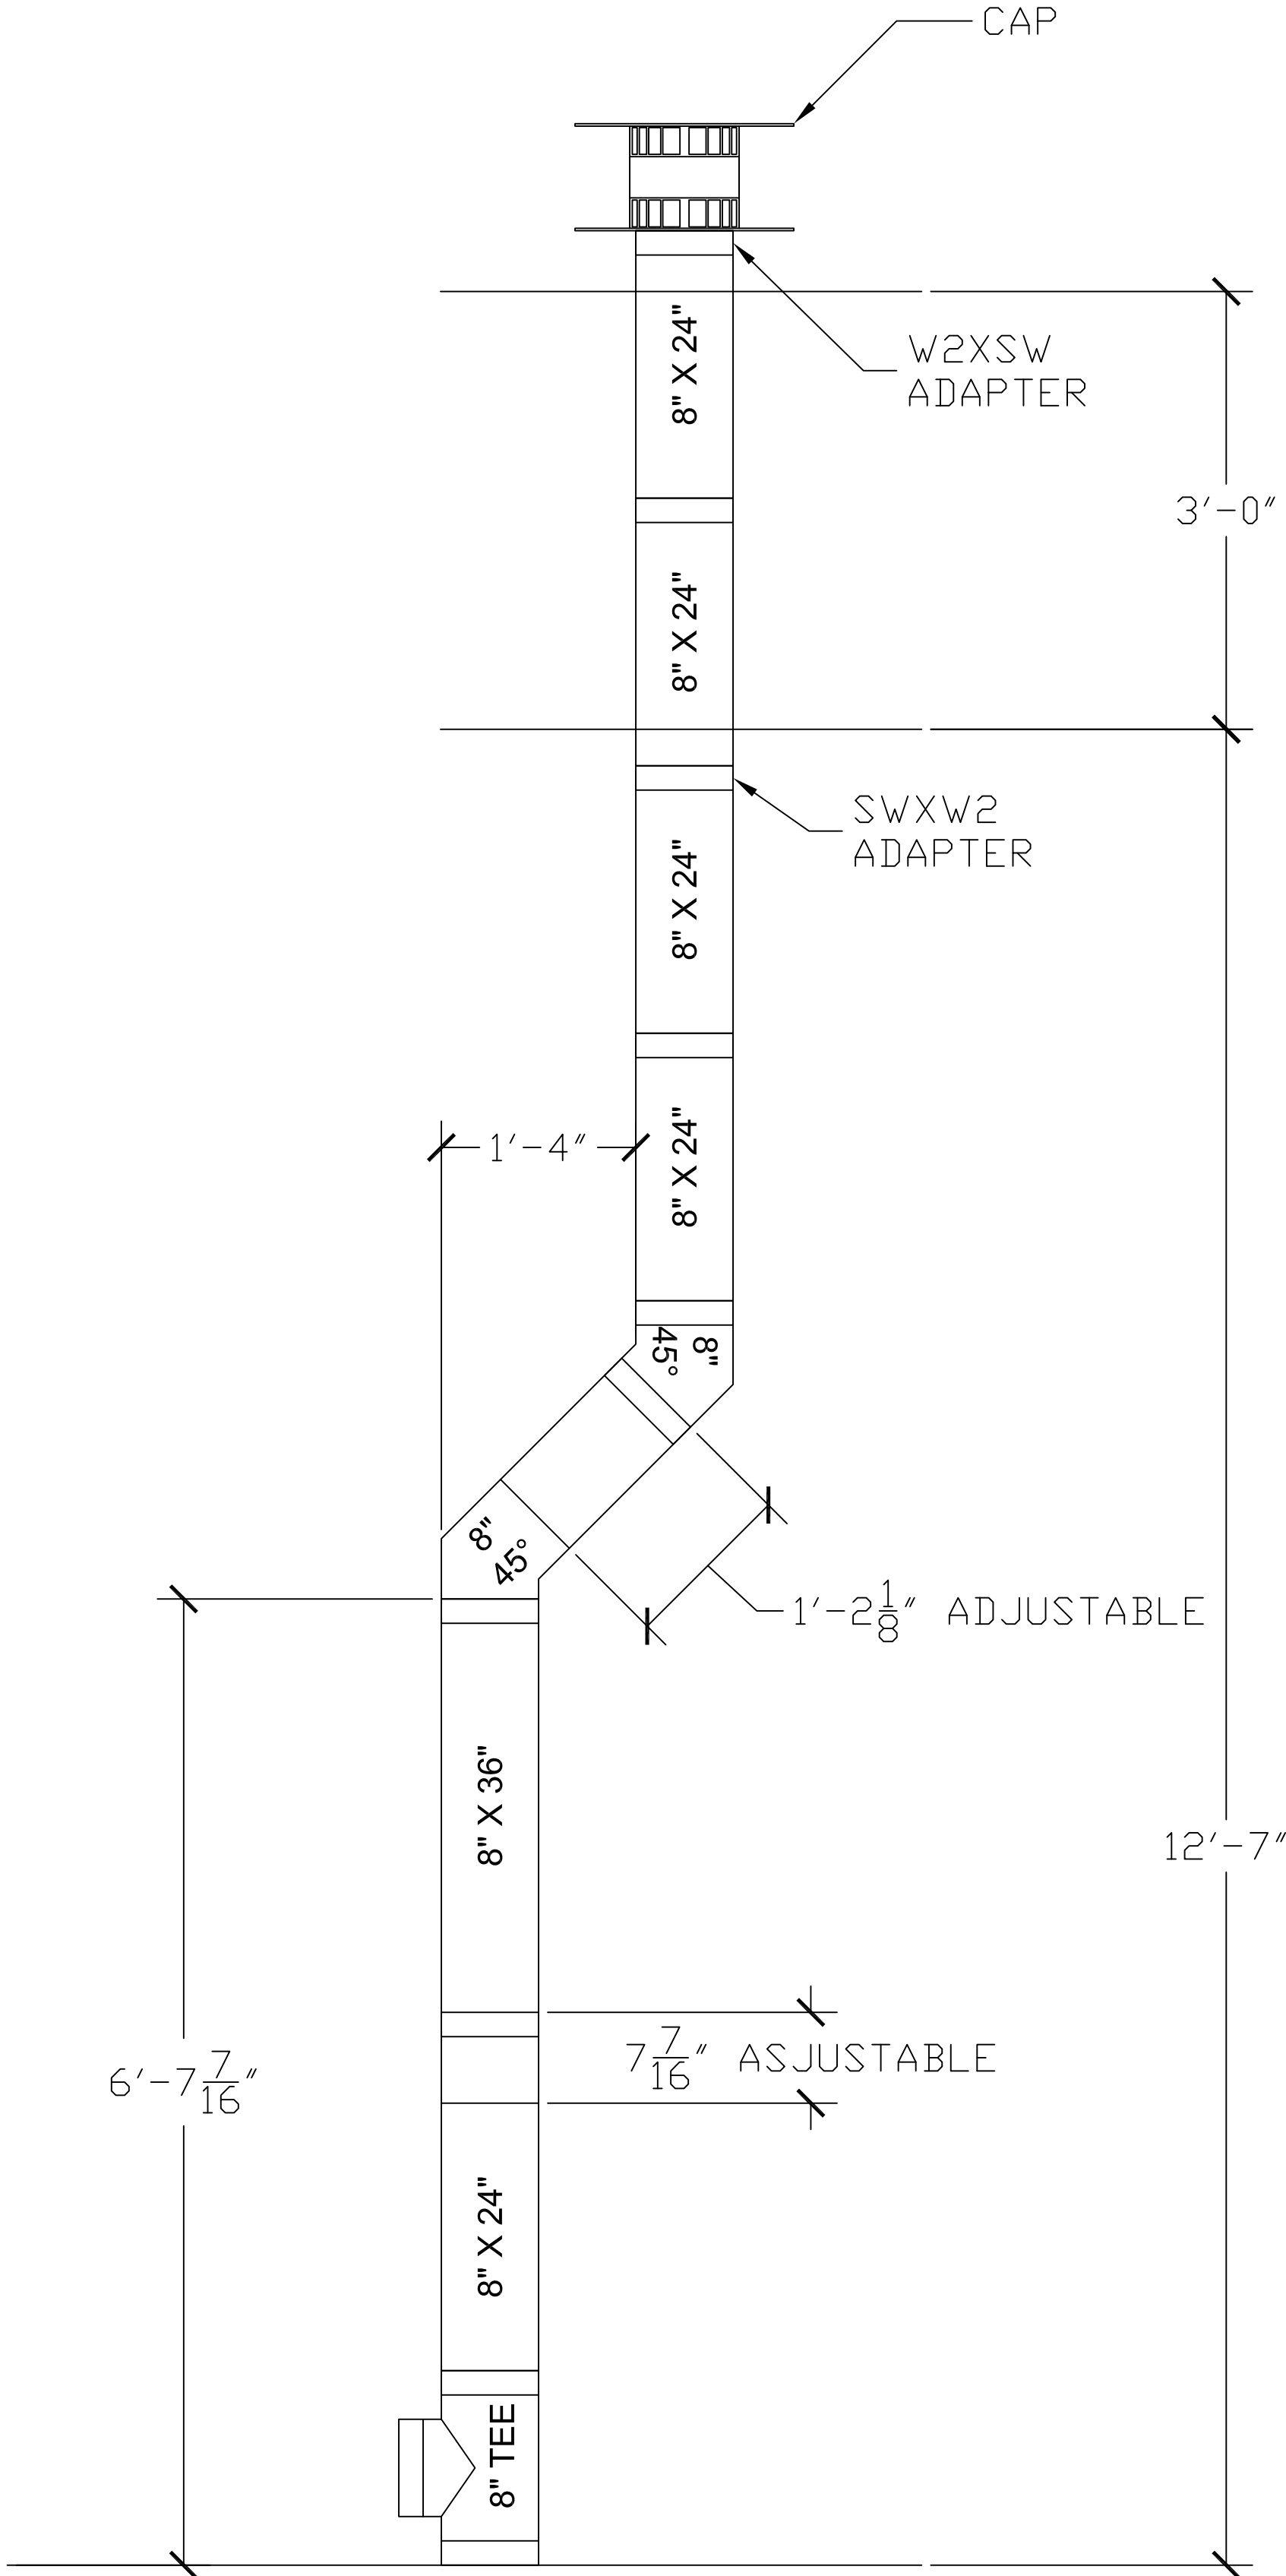

LIABILITY
This drawing and our recommendations and suggestions, are intended to assist our customers. Our design represents our best judgment based on our experience and the best facts provided to us, any use thereof is at the sole risk of the customer.
It is assumed that the customer will install the THAW-PAK system in compliance with all local, state and national codes.

THAW-PAK DISTRIBUTOR:



PERFORMANCE
engineering group

PROJECT NAME:

BOULEVARD TEMPLE
VENTING

MICHIGAN

CONSULTANTS:

-

ADDRESS

CITY

MICHIGAN

DRAWN BY:
Gordon Faustich

REVIEWED BY:
CM

APPROVED BY:
CM

ISSUED FOR

04/18/11

INSTALLATION

PROPERTY OF THAW-PAK
This drawing is the property of THAW-PAK, it has been prepared to assist in the installation of our system. Customer agrees to keep confidential and not disclose this drawing or copies thereof without our written consent.

DRAWING NO.

BOULEVARD
TEMPLE VENTING

SHEET NO.

M1