


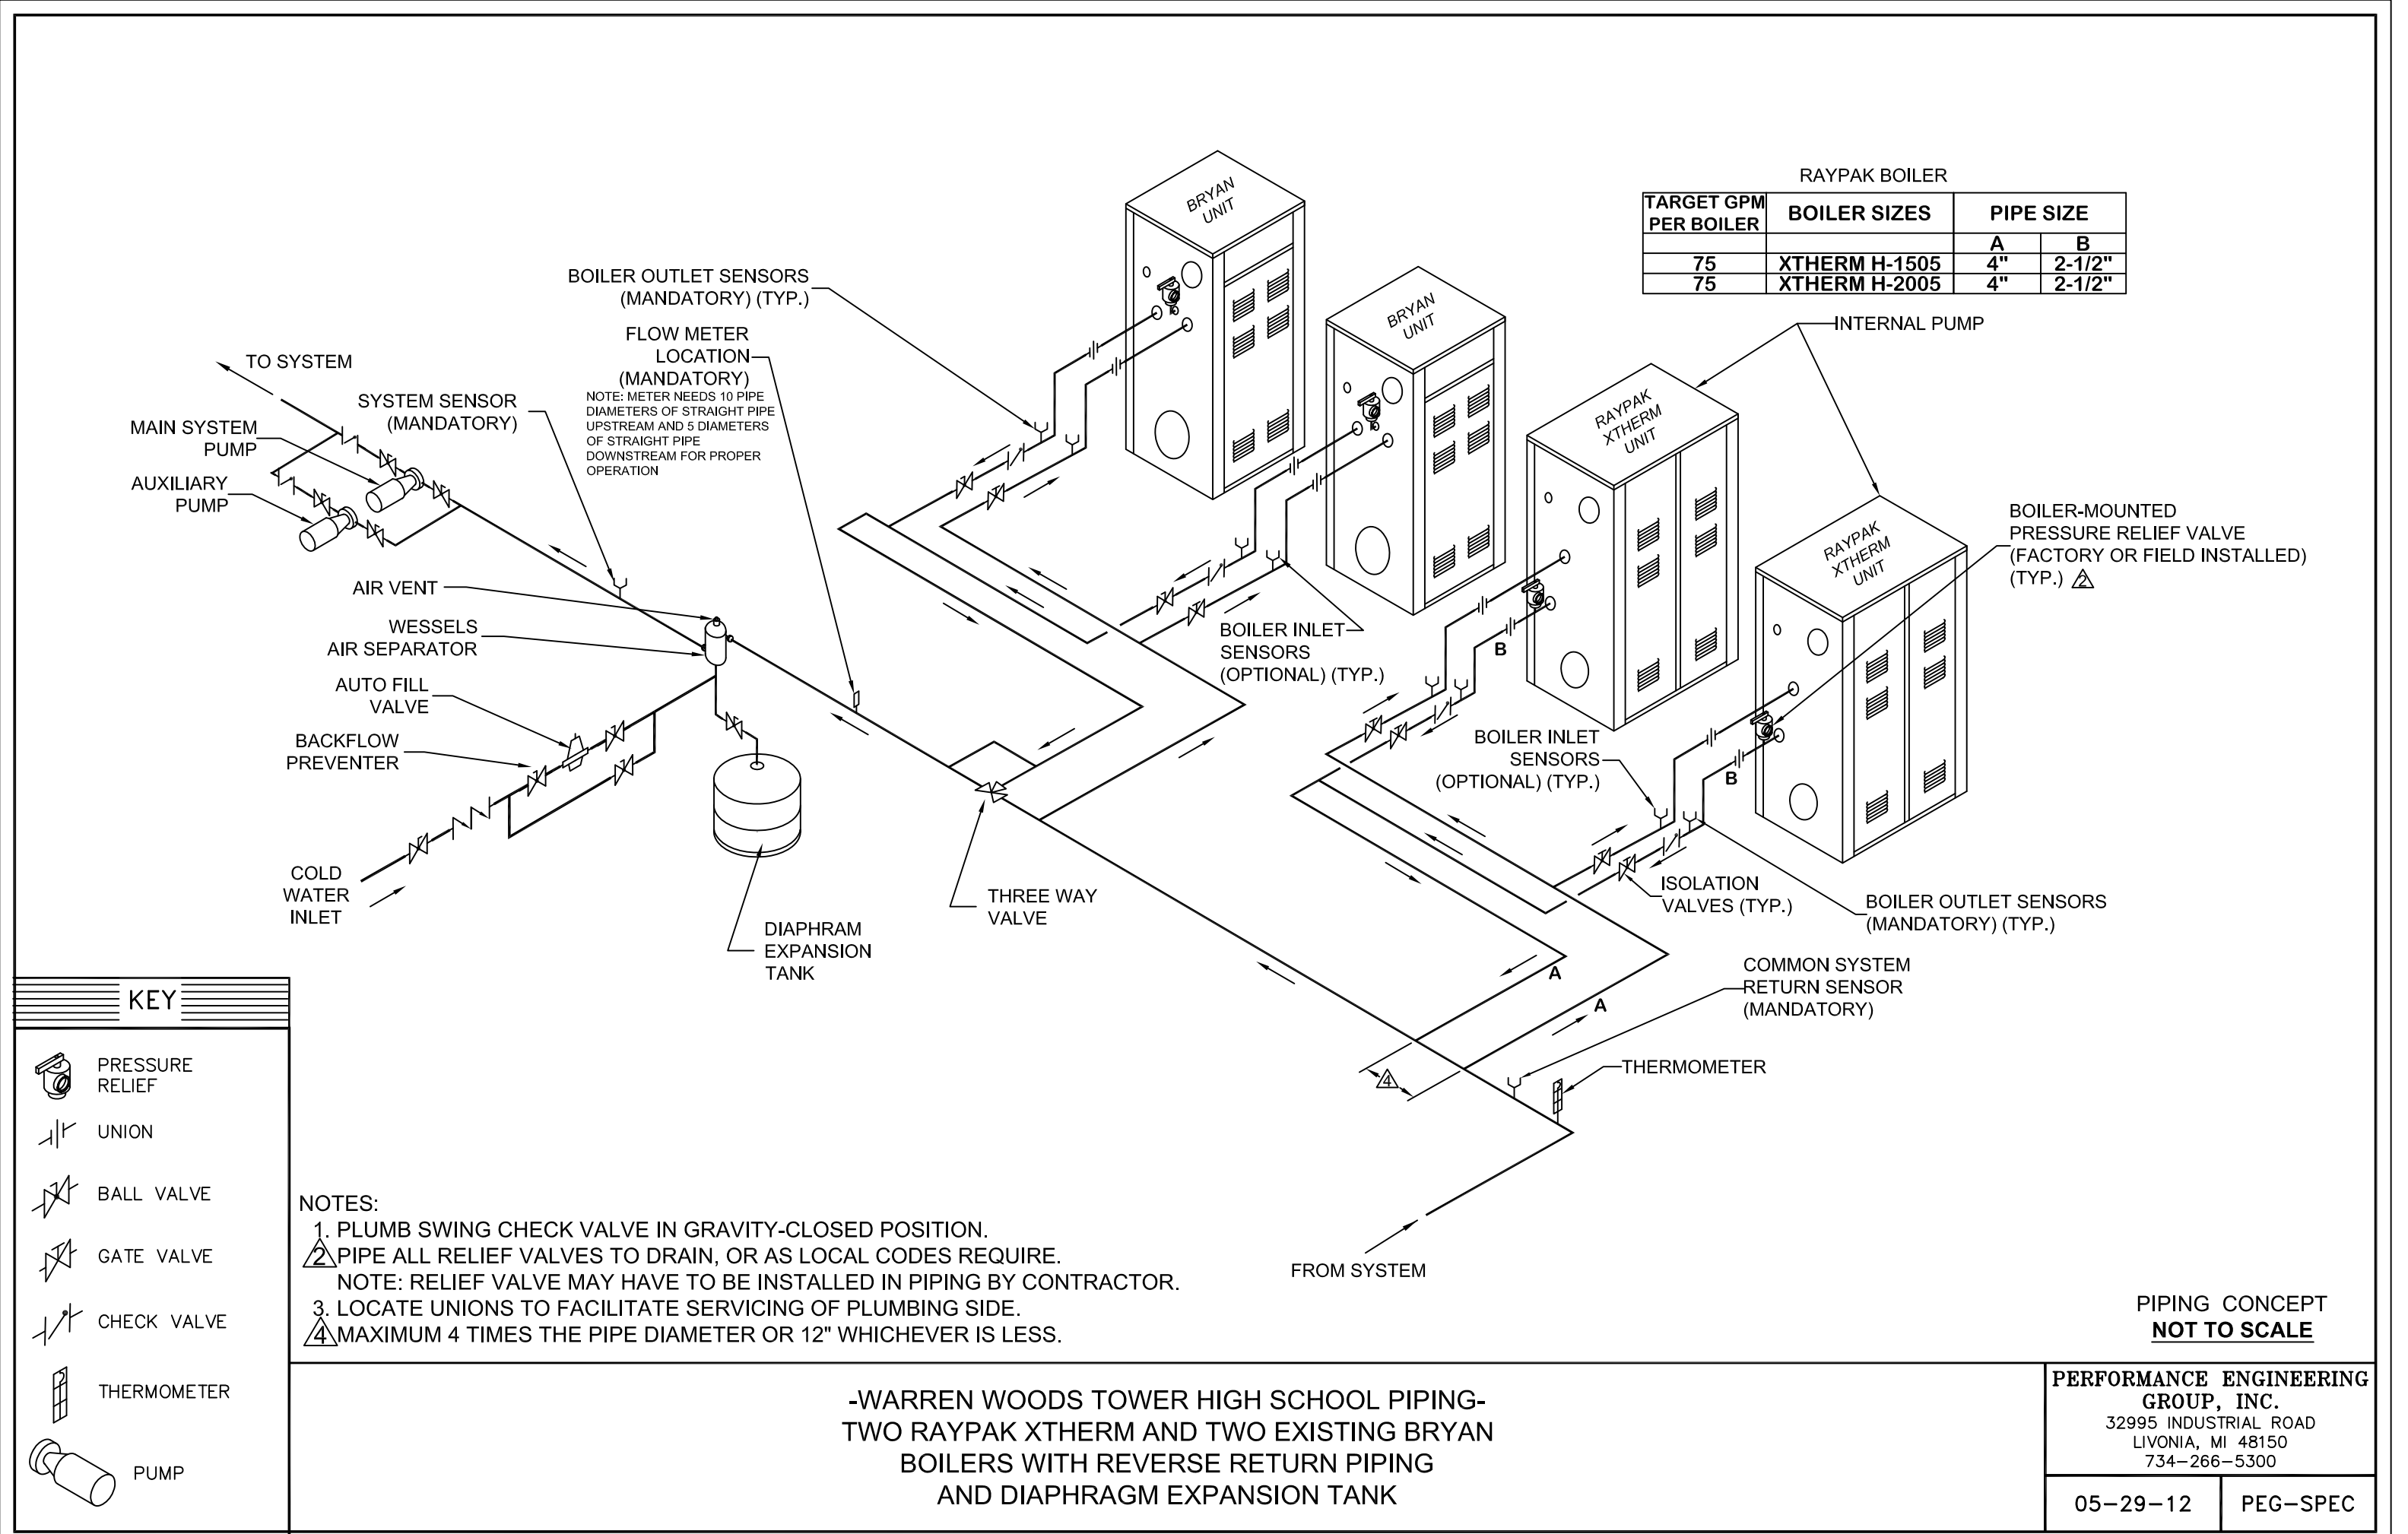

RAYPAK BOILER			
TARGET GPM PER BOILER	BOILER SIZES	PIPE SIZE	
		A	B
75	XTHERM H-1505	4"	2-1/2"
75	XTHERM H-2005	4"	2-1/2"

- NOTES:
- 1. PLUMB SWING CHECK VALVE IN GRAVITY-CLOSED POSITION.
 - 2. PIPE ALL RELIEF VALVES TO DRAIN, OR AS LOCAL CODES REQUIRE.
NOTE: RELIEF VALVE MAY HAVE TO BE INSTALLED IN PIPING BY CONTRACTOR.
 - 3. LOCATE UNIONS TO FACILITATE SERVICING OF PLUMBING SIDE.
 - 4. MAXIMUM 4 TIMES THE PIPE DIAMETER OR 12" WHICHEVER IS LESS.

-WARREN WOODS TOWER HIGH SCHOOL PIPING-
TWO RAYPAK XTHERM AND TWO EXISTING BRYAN
BOILERS WITH REVERSE RETURN PIPING
AND DIAPHRAGM EXPANSION TANK

PIPING CONCEPT
NOT TO SCALE

PERFORMANCE ENGINEERING
GROUP, INC.
32995 INDUSTRIAL ROAD
LIVONIA, MI 48150
734-266-5300

05-29-12 PEG-SPEC